

Report Name: Interior Health Monthly Report

Water System Data Report Filter Summary

Organization:	City of Cranbrook
User Name:	Jodi Schmideder
Water System:	City of Cranbrook
Report Description:	Report to Interior Health Authority for the City of Cranbrook.
Report Template Name:	Interior Health Monthly Report
Collection Date Range:	04/01/2026 - 04/29/2026 (mm/dd/yyyy)
Report Type:	Analyte Report by Sampling Point
Reading Types:	Calculated, Lab Data Transfer, Test Kit
Calculate Exceedances:	Apply Measurement Criteria
Show Records for Exceedances Only:	No
Suppress Lists with no Records:	Yes
Treatment of ND Results with Detection Limits in Reports Statistics:	Non-Detect (results are ignored in average statistics)
Treatment of OR Results with Detection Limits in Reports Statistics:	Over-Range (results are ignored in average statistics)
Grouped By:	Sampling Point, List by: Analyte + Reading Type
Sort Records By:	Sampling Point Name

Facility:	Distribution Sample Sites
Sampling Point:	PR 1 Sampling Tap - PRIORITY (1-1-MD, 305F9)

DISINFECTANTS

Chlorine (free)(Test Kit)

# samples:	5	min:	1.01	mg/L
# detects:	5	max:	1.21	mg/L
# non-detects:	0	avg:	1.12	mg/L (based on 5 numerical results)
# exceedances:	0			

Chlorine (total)(Test Kit)

# samples:	5	min:	1.19	mg/L
# detects:	5	max:	1.34	mg/L
# non-detects:	0	avg:	1.27	mg/L (based on 5 numerical results)
# exceedances:	0			

INORGANIC

Fluoride(Lab Data Transfer)

# samples:	1	min:	0.43	mg/L
# detects:	1	max:	0.43	mg/L
# non-detects:	0	avg:	0.43	mg/L (based on 1 numerical results)
# exceedances:	0			

Manganese (dissolved)(Test Kit)

# samples:	1	min:	0.014	mg/L
# detects:	1	max:	0.014	mg/L
# non-detects:	0	avg:	0.014	mg/L (based on 1 numerical results)
# exceedances:	0			

MICROORGANISMS

Escherichia coli / E. coli (counts)(Lab Data Transfer)

# samples:	1	min:	0	counts/100ml
# detects:	1	max:	0	counts/100ml
# non-detects:	0	Geometric Mean	0	counts/100ml (based on 1 numerical results)
# exceedances:	0			

Total Coliforms (counts)(Lab Data Transfer)

# samples:	1	min:	0	counts/100ml
# detects:	1	max:	0	counts/100ml
# non-detects:	0	Geometric Mean	0	counts/100ml (based on 1 numerical results)
# exceedances:	0			

PHYSICAL

Conductivity(Lab Data Transfer)

# samples:	1	min:	210	uS/cm
# detects:	1	max:	210	uS/cm
# non-detects:	0	avg:	210	uS/cm (based on 1 numerical results)
# exceedances:	0			

Conductivity(Test Kit)

# samples:	5	min:	92.6	uS/cm
# detects:	5	max:	209.9	uS/cm
# non-detects:	0	avg:	171.6	uS/cm (based on 5 numerical results)
# exceedances:	0			

pH(Lab Data Transfer)

# samples:	1	min:	7.35	
------------	---	------	------	--

# detects:	1	max:	7.35	
# non-detects:	0	avg:	7.35	(based on 1 numerical results)
# exceedances:	0			

pH(Test Kit)

# samples:	5	min:	7.06	
# detects:	5	max:	8.61	
# non-detects:	0	avg:	7.77	(based on 5 numerical results)
# exceedances:	0			

Temperature(Test Kit)

# samples:	5	min:	7.1	degrees C
# detects:	5	max:	9.7	degrees C
# non-detects:	0	avg:	8.6	degrees C (based on 5 numerical results)
# exceedances:	0			

Turbidity(Lab Data Transfer)

# samples:	1	min:	0.84	NTU
# detects:	1	max:	0.84	NTU
# non-detects:	0	avg:	0.84	NTU (based on 1 numerical results)
# exceedances:	0	95th percentile:	0.84	NTU

Turbidity(Test Kit)

# samples:	5	min:	0.90	NTU
# detects:	5	max:	2.38	NTU
# non-detects:	0	avg:	1.36	NTU (based on 5 numerical results)
# exceedances:	0	95th percentile:	2.38	NTU

Facility:	Distribution Sample Sites
Sampling Point:	PR 2 Sampling Tap PRIORITY (1-2-MD, 305FA)

DISINFECTANTS

Chlorine (free)(Test Kit)

# samples:	5	min:	0.56	mg/L
# detects:	5	max:	0.71	mg/L
# non-detects:	0	avg:	0.65	mg/L (based on 5 numerical results)
# exceedances:	0			

Chlorine (total)(Test Kit)

# samples:	4	min:	0.78	mg/L
------------	---	------	------	------

# detects:	4	max:	0.86	mg/L
# non-detects:	0	avg:	0.82	mg/L (based on 4 numerical results)
# exceedances:	0			

INORGANIC

Manganese (dissolved)(Test Kit)

# samples:	1	min:	0.034	mg/L
# detects:	1	max:	0.034	mg/L
# non-detects:	0	avg:	0.034	mg/L (based on 1 numerical results)
# exceedances:	0			

MICROORGANISMS

Escherichia coli / E. coli (counts)(Lab Data Transfer)

# samples:	1	min:	0	counts/100ml
# detects:	1	max:	0	counts/100ml
# non-detects:	0	Geometric Mean	0	counts/100ml (based on 1 numerical results)
# exceedances:	0			

Total Coliforms (counts)(Lab Data Transfer)

# samples:	1	min:	0	counts/100ml
# detects:	1	max:	0	counts/100ml
# non-detects:	0	Geometric Mean	0	counts/100ml (based on 1 numerical results)
# exceedances:	0			

PHYSICAL

Conductivity(Test Kit)

# samples:	4	min:	153.2	uS/cm
# detects:	4	max:	198.2	uS/cm
# non-detects:	0	avg:	169.6	uS/cm (based on 4 numerical results)
# exceedances:	0			

pH(Test Kit)

# samples:	4	min:	7.14	
# detects:	4	max:	8.92	
# non-detects:	0	avg:	8.07	(based on 4 numerical results)
# exceedances:	0			

Temperature(Test Kit)

# samples:	4	min:	7.9	degrees C
# detects:	4	max:	8.4	degrees C
# non-detects:	0	avg:	8.2	degrees C (based on 4 numerical results)
# exceedances:	0			

Turbidity(Test Kit)

# samples:	4	min:	0.63	NTU
# detects:	4	max:	1.26	NTU
# non-detects:	0	avg:	0.87	NTU (based on 4 numerical results)
# exceedances:	0	95th percentile:	1.26	NTU

Facility:	Distribution Sample Sites
Sampling Point:	PR 4- Sample Tap (1-16-MD, 30672)

DISINFECTANTS

Chlorine (free)(Test Kit)

# samples:	2	min:	0.80	mg/L
# detects:	2	max:	0.92	mg/L
# non-detects:	0	avg:	0.86	mg/L (based on 2 numerical results)
# exceedances:	0			

Chlorine (total)(Test Kit)

# samples:	1	min:	1.09	mg/L
# detects:	1	max:	1.09	mg/L
# non-detects:	0	avg:	1.09	mg/L (based on 1 numerical results)
# exceedances:	0			

INORGANIC

Manganese (dissolved)(Test Kit)

# samples:	1	min:	0.014	mg/L
# detects:	1	max:	0.014	mg/L
# non-detects:	0	avg:	0.014	mg/L (based on 1 numerical results)
# exceedances:	0			

MICROORGANISMS

Escherichia coli / E. coli (counts)(Lab Data Transfer)

# samples:	1	min:	0	counts/100ml
# detects:	1	max:	0	counts/100ml
# non-detects:	0	Geometric Mean	0	counts/100ml (based on 1 numerical results)
# exceedances:	0			

Total Coliforms (counts)(Lab Data Transfer)

# samples:	1	min:	0	counts/100ml
# detects:	1	max:	0	counts/100ml
# non-detects:	0	Geometric Mean	0	counts/100ml (based on 1 numerical results)
# exceedances:	0			

PHYSICAL

Turbidity(Test Kit)

# samples:	2	min:	0.83	NTU
# detects:	2	max:	1.31	NTU
# non-detects:	0	avg:	1.07	NTU (based on 2 numerical results)
# exceedances:	0	95th percentile:	1.31	NTU

Facility:	Distribution Sample Sites
Sampling Point:	PR 9 Sampling Tap PRIORITY (1-3-MD, 305FB)

DISINFECTANTS

Chlorine (free)(Test Kit)

# samples:	5	min:	0.61	mg/L
# detects:	5	max:	0.83	mg/L
# non-detects:	0	avg:	0.67	mg/L (based on 5 numerical results)
# exceedances:	0			

Chlorine (total)(Test Kit)

# samples:	5	min:	0.73	mg/L
# detects:	5	max:	1.04	mg/L
# non-detects:	0	avg:	0.85	mg/L (based on 5 numerical results)
# exceedances:	0			

INORGANIC

Fluoride(Lab Data Transfer)

# samples:	1	min:	0.44	mg/L
# detects:	1	max:	0.44	mg/L
# non-detects:	0	avg:	0.44	mg/L (based on 1 numerical results)
# exceedances:	0			

Manganese (dissolved)(Test Kit)

# samples:	1	min:	0.015	mg/L
# detects:	1	max:	0.015	mg/L
# non-detects:	0	avg:	0.015	mg/L (based on 1 numerical results)
# exceedances:	0			

MICROORGANISMS

Escherichia coli / E. coli (counts)(Lab Data Transfer)

# samples:	1	min:	0	counts/100ml
# detects:	1	max:	0	counts/100ml
# non-detects:	0	Geometric Mean	0	counts/100ml (based on 1 numerical results)
# exceedances:	0			

Total Coliforms (counts)(Lab Data Transfer)

# samples:	1	min:	0	counts/100ml
# detects:	1	max:	0	counts/100ml
# non-detects:	0	Geometric Mean	0	counts/100ml (based on 1 numerical results)
# exceedances:	0			

PHYSICAL

Conductivity(Lab Data Transfer)

# samples:	1	min:	210	uS/cm
# detects:	1	max:	210	uS/cm
# non-detects:	0	avg:	210	uS/cm (based on 1 numerical results)
# exceedances:	0			

Conductivity(Test Kit)

# samples:	5	min:	91.4	uS/cm
# detects:	5	max:	208.7	uS/cm
# non-detects:	0	avg:	166.1	uS/cm (based on 5 numerical results)
# exceedances:	0			

pH(Lab Data Transfer)

# samples:	1	min:	7.29	
# detects:	1	max:	7.29	
# non-detects:	0	avg:	7.29	(based on 1 numerical results)
# exceedances:	0			

pH(Test Kit)

# samples:	5	min:	7.23	
------------	---	------	------	--

# detects:	5	max:	8.67	
# non-detects:	0	avg:	7.93	(based on 5 numerical results)
# exceedances:	0			

Temperature(Test Kit)

# samples:	5	min:	7.0	degrees C
# detects:	5	max:	8.6	degrees C
# non-detects:	0	avg:	7.7	degrees C (based on 5 numerical results)
# exceedances:	0			

Turbidity(Lab Data Transfer)

# samples:	1	min:	0.95	NTU
# detects:	1	max:	0.95	NTU
# non-detects:	0	avg:	0.95	NTU (based on 1 numerical results)
# exceedances:	0	95th percentile:	0.95	NTU

Turbidity(Test Kit)

# samples:	5	min:	0.53	NTU
# detects:	5	max:	0.98	NTU
# non-detects:	0	avg:	0.84	NTU (based on 5 numerical results)
# exceedances:	0	95th percentile:	0.98	NTU

Facility:	Distribution Sample Sites
Sampling Point:	Well #3 - Pump On Raw PRIORITY (1-22-EP, 31E8C)

INORGANIC

Manganese (dissolved)(Test Kit)

# samples:	1	min:	0.034	mg/L
# detects:	1	max:	0.034	mg/L
# non-detects:	0	avg:	0.034	mg/L (based on 1 numerical results)
# exceedances:	0			

MICROORGANISMS

Escherichia coli / E. coli (counts)(Lab Data Transfer)

# samples:	4	min:	0	counts/100ml
# detects:	4	max:	7.0	counts/100ml
# non-detects:	0	Geometric Mean	1.9	counts/100ml (based on 4 numerical results)
# exceedances:	1			

Total Coliforms (counts)(Lab Data Transfer)

# samples:	4	min:	0	counts/100ml
# detects:	4	max:	14	counts/100ml
# non-detects:	0	Geometric Mean 2		counts/100ml (based on 4 numerical results)
# exceedances:	1			

PHYSICAL

Conductivity(Test Kit)

# samples:	12	min:	350	uS/cm
# detects:	12	max:	887	uS/cm
# non-detects:	0	avg:	717	uS/cm (based on 12 numerical results)
# exceedances:	0			

pH(Test Kit)

# samples:	12	min:	6.94	
# detects:	12	max:	8.02	
# non-detects:	0	avg:	7.42	(based on 12 numerical results)
# exceedances:	0			

Temperature(Test Kit)

# samples:	12	min:	8.8	degrees C
# detects:	12	max:	11.5	degrees C
# non-detects:	0	avg:	10.3	degrees C (based on 12 numerical results)
# exceedances:	0			

Turbidity(Test Kit)

# samples:	12	min:	0.13	NTU
# detects:	12	max:	0.50	NTU
# non-detects:	0	avg:	0.24	NTU (based on 12 numerical results)
# exceedances:	0	95th percentile:	0.50	NTU

Facility:	Distribution Sample Sites
Sampling Point:	Well #3- Pump On Potable PRIORITY (1-21-EP, 31E8B)

DISINFECTANTS

Chlorine (free)(Test Kit)

# samples:	12	min:	0.63	mg/L
# detects:	12	max:	1.11	mg/L
# non-detects:	0	avg:	0.88	mg/L (based on 12 numerical results)
# exceedances:	0			

Chlorine (total)(Test Kit)

# samples:	12	min:	0.70	mg/L
# detects:	12	max:	1.65	mg/L
# non-detects:	0	avg:	0.99	mg/L (based on 12 numerical results)
# exceedances:	0			

MICROORGANISMS

Escherichia coli / E. coli (counts)(Lab Data Transfer)

# samples:	4	min:	0	counts/100ml
# detects:	4	max:	0	counts/100ml
# non-detects:	0	Geometric Mean	0	counts/100ml (based on 4 numerical results)
# exceedances:	0			

Total Coliforms (counts)(Lab Data Transfer)

# samples:	4	min:	0	counts/100ml
# detects:	4	max:	0	counts/100ml
# non-detects:	0	Geometric Mean	0	counts/100ml (based on 4 numerical results)
# exceedances:	0			

PHYSICAL

Conductivity(Test Kit)

# samples:	12	min:	352	uS/cm
# detects:	12	max:	872	uS/cm
# non-detects:	0	avg:	718	uS/cm (based on 12 numerical results)
# exceedances:	0			

pH(Test Kit)

# samples:	12	min:	6.87	
# detects:	12	max:	7.97	
# non-detects:	0	avg:	7.36	(based on 12 numerical results)
# exceedances:	0			

Temperature(Test Kit)

# samples:	12	min:	9.3	degrees C
# detects:	12	max:	12.3	degrees C
# non-detects:	0	avg:	10.2	degrees C (based on 12 numerical results)
# exceedances:	0			

Turbidity(Test Kit)

# samples:	12	min:	0.15	NTU
# detects:	12	max:	0.52	NTU
# non-detects:	0	avg:	0.29	NTU (based on 12 numerical results)
# exceedances:	0	95th percentile:	0.52	NTU

Facility:	Distribution Sample Sites			
Sampling Point:	Well #4. Pump On - Potable PRIORITY (1-27-EP, 3425D)			

DISINFECTANTS

Chlorine (free)(Test Kit)

# samples:	12	min:	0.71	mg/L
# detects:	12	max:	0.91	mg/L
# non-detects:	0	avg:	0.80	mg/L (based on 12 numerical results)
# exceedances:	0			

Chlorine (total)(Test Kit)

# samples:	12	min:	0.77	mg/L
# detects:	12	max:	1.04	mg/L
# non-detects:	0	avg:	0.91	mg/L (based on 12 numerical results)
# exceedances:	0			

PHYSICAL

Conductivity(Test Kit)

# samples:	11	min:	339	uS/cm
# detects:	11	max:	721	uS/cm
# non-detects:	0	avg:	603	uS/cm (based on 11 numerical results)
# exceedances:	0			

pH(Test Kit)

# samples:	12	min:	6.34	
# detects:	12	max:	8.04	
# non-detects:	0	avg:	7.43	(based on 12 numerical results)
# exceedances:	0			

Temperature(Test Kit)

# samples:	12	min:	9.4	degrees C
# detects:	12	max:	12.2	degrees C
# non-detects:	0	avg:	10.55	degrees C (based on 12 numerical results)

# exceedances:	0
----------------	---

Turbidity(Test Kit)

# samples:	12	min:	0.14	NTU
# detects:	12	max:	0.87	NTU
# non-detects:	0	avg:	0.46	NTU (based on 12 numerical results)
# exceedances:	0	95th percentile:	0.87	NTU

Facility:	Distribution Sample Sites
Sampling Point:	Well #4. Pump On - Raw PRIORITY (1-26-EP, 3425C)

INORGANIC

Fluoride(Lab Data Transfer)

# samples:	1	min:	0.12	mg/L
# detects:	1	max:	0.12	mg/L
# non-detects:	0	avg:	0.12	mg/L (based on 1 numerical results)
# exceedances:	0			

Manganese (dissolved)(Test Kit)

# samples:	1	min:	0.034	mg/L
# detects:	1	max:	0.034	mg/L
# non-detects:	0	avg:	0.034	mg/L (based on 1 numerical results)
# exceedances:	0			

MICROORGANISMS

Escherichia coli / E. coli (counts)(Lab Data Transfer)

# samples:	2	min:	0	counts/100ml
# detects:	2	max:	0	counts/100ml
# non-detects:	0	Geometric Mean	0	counts/100ml (based on 2 numerical results)
# exceedances:	0			

Total Coliforms (counts)(Lab Data Transfer)

# samples:	2	min:	0	counts/100ml
# detects:	2	max:	0	counts/100ml
# non-detects:	0	Geometric Mean	0	counts/100ml (based on 2 numerical results)
# exceedances:	0			

PHYSICAL

Conductivity(Lab Data Transfer)

# samples:	1	min:	700	uS/cm
# detects:	1	max:	700	uS/cm
# non-detects:	0	avg:	700	uS/cm (based on 1 numerical results)
# exceedances:	0			

Conductivity(Test Kit)

# samples:	10	min:	339	uS/cm
# detects:	10	max:	727	uS/cm
# non-detects:	0	avg:	593	uS/cm (based on 10 numerical results)
# exceedances:	0			

pH(Lab Data Transfer)

# samples:	1	min:	8.08	
# detects:	1	max:	8.08	
# non-detects:	0	avg:	8.08	(based on 1 numerical results)
# exceedances:	0			

pH(Test Kit)

# samples:	11	min:	6.80	
# detects:	11	max:	7.93	
# non-detects:	0	avg:	7.48	(based on 11 numerical results)
# exceedances:	0			

Temperature(Test Kit)

# samples:	11	min:	9.5	degrees C
# detects:	11	max:	11.3	degrees C
# non-detects:	0	avg:	10.0	degrees C (based on 11 numerical results)
# exceedances:	0			

Turbidity(Lab Data Transfer)

# samples:	1	min:	0.31	NTU
# detects:	1	max:	0.31	NTU
# non-detects:	0	avg:	0.31	NTU (based on 1 numerical results)
# exceedances:	0	95th percentile:	0.31	NTU

Turbidity(Test Kit)

# samples:	11	min:	0.04	NTU
# detects:	11	max:	0.73	NTU
# non-detects:	0	avg:	0.33	NTU (based on 11 numerical results)
# exceedances:	0	95th percentile:	0.73	NTU

Facility:	Phillips Reservoir; Phillips Reservoir - Plant
Sampling Point:	Phillips Reservoir POTABLE PRIORITY (16-1-IT, 30653)

DISINFECTANTS

Chlorine (free)(Test Kit)

# samples:	18	min:	1.17	mg/L
# detects:	18	max:	1.72	mg/L
# non-detects:	0	avg:	1.58	mg/L (based on 18 numerical results)
# exceedances:	0			

Chlorine (total)(Test Kit)

# samples:	18	min:	1.65	mg/L
# detects:	18	max:	1.92	mg/L
# non-detects:	0	avg:	1.78	mg/L (based on 18 numerical results)
# exceedances:	0			

INORGANIC

Dissolved Oxygen(Test Kit)

# samples:	18	min:	10.35	mg/L
# detects:	18	max:	12.05	mg/L
# non-detects:	0	avg:	11.00	mg/L (based on 18 numerical results)
# exceedances:	0			

Fluoride(Lab Data Transfer)

# samples:	3	min:	0.42	mg/L
# detects:	3	max:	0.46	mg/L
# non-detects:	0	avg:	0.44	mg/L (based on 3 numerical results)
# exceedances:	0			

MICROORGANISMS

Escherichia coli / E. coli (counts)(Lab Data Transfer)

# samples:	2	min:	0	counts/100ml
# detects:	2	max:	0	counts/100ml
# non-detects:	0	Geometric Mean	0	counts/100ml (based on 2 numerical results)
# exceedances:	0			

Total Coliforms (counts)(Lab Data Transfer)

# samples:	2	min:	1.0	counts/100ml
# detects:	2	max:	1.0	counts/100ml
# non-detects:	0	Geometric Mean	1.0	counts/100ml (based on 2 numerical results)
# exceedances:	2			

PHYSICAL

Conductivity(Lab Data Transfer)

# samples:	3	min:	200	uS/cm
# detects:	3	max:	210	uS/cm
# non-detects:	0	avg:	207	uS/cm (based on 3 numerical results)
# exceedances:	0			

Conductivity(Test Kit)

# samples:	18	min:	148.1	uS/cm
# detects:	18	max:	206	uS/cm
# non-detects:	0	avg:	169.6	uS/cm (based on 18 numerical results)
# exceedances:	0			

pH(Lab Data Transfer)

# samples:	3	min:	7.23	
# detects:	3	max:	7.37	
# non-detects:	0	avg:	7.32	(based on 3 numerical results)
# exceedances:	0			

pH(Test Kit)

# samples:	18	min:	6.65	
# detects:	18	max:	8.77	
# non-detects:	0	avg:	7.50	(based on 18 numerical results)
# exceedances:	0			

Temperature(Test Kit)

# samples:	18	min:	5.7	degrees C
# detects:	18	max:	14.2	degrees C
# non-detects:	0	avg:	7.6	degrees C (based on 18 numerical results)
# exceedances:	0			

Turbidity(Lab Data Transfer)

# samples:	3	min:	0.76	NTU
# detects:	3	max:	1.0	NTU
# non-detects:	0	avg:	0.84	NTU (based on 3 numerical results)

# exceedances:	0	95th percentile:	1.00	NTU
----------------	---	------------------	------	-----

Turbidity(Test Kit)

# samples:	18	min:	0.76	NTU
# detects:	18	max:	1.29	NTU
# non-detects:	0	avg:	0.94	NTU (based on 18 numerical results)
# exceedances:	0	95th percentile:	1.29	NTU

Facility:	Phillips Reservoir; Phillips Reservoir - Plant
Sampling Point:	Phillips Reservoir RAW PRIORITY (16-2-SR, 30666)

INORGANIC

Dissolved Oxygen(Test Kit)

# samples:	18	min:	10.42	mg/L
# detects:	18	max:	12.03	mg/L
# non-detects:	0	avg:	11.11	mg/L (based on 18 numerical results)
# exceedances:	0			

Fluoride(Lab Data Transfer)

# samples:	3	min:	< 0.050	mg/L
# detects:	0	max:	< 0.050	mg/L
# non-detects:	3	avg:	n/a	(based on 0 numerical results)
# exceedances:	0			

Manganese (dissolved)(Test Kit)

# samples:	1	min:	0.013	mg/L
# detects:	1	max:	0.013	mg/L
# non-detects:	0	avg:	0.013	mg/L (based on 1 numerical results)
# exceedances:	0			

MICROORGANISMS

Escherichia coli / E. coli (counts)(Lab Data Transfer)

# samples:	2	min:	0	counts/100ml
# detects:	2	max:	1.0	counts/100ml
# non-detects:	0	Geometric Mean	1.0	counts/100ml (based on 2 numerical results)
# exceedances:	1			

Total Coliforms (counts)(Lab Data Transfer)

# samples:	2	min:	66	CFU/100ml
------------	---	------	----	-----------

# detects:	2	max:	91	CFU/100ml
# non-detects:	0	Geometric Mean	77	CFU/100ml (based on 2 numerical results)
# exceedances:	0			

PHYSICAL

Conductivity(Lab Data Transfer)

# samples:	3	min:	200	uS/cm
# detects:	3	max:	200	uS/cm
# non-detects:	0	avg:	200	uS/cm (based on 3 numerical results)
# exceedances:	0			

Conductivity(Test Kit)

# samples:	18	min:	147.8	uS/cm
# detects:	18	max:	207.5	uS/cm
# non-detects:	0	avg:	167.4	uS/cm (based on 18 numerical results)
# exceedances:	0			

pH(Lab Data Transfer)

# samples:	3	min:	7.39	
# detects:	3	max:	7.50	
# non-detects:	0	avg:	7.45	(based on 3 numerical results)
# exceedances:	0			

pH(Test Kit)

# samples:	18	min:	6.68	
# detects:	18	max:	8.34	
# non-detects:	0	avg:	7.52	(based on 18 numerical results)
# exceedances:	0			

Temperature(Test Kit)

# samples:	18	min:	6	degrees C
# detects:	18	max:	9.5	degrees C
# non-detects:	0	avg:	7.4	degrees C (based on 18 numerical results)
# exceedances:	0			

Turbidity(Lab Data Transfer)

# samples:	3	min:	0.74	NTU
# detects:	3	max:	0.82	NTU
# non-detects:	0	avg:	0.78	NTU (based on 3 numerical results)
# exceedances:	0	95th percentile:	0.82	NTU

Turbidity(Test Kit)



# samples:	18	min:	0.75	NTU
# detects:	18	max:	1.15	NTU
# non-detects:	0	avg:	0.91	NTU (based on 18 numerical results)
# exceedances:	3	95th percentile:	1.15	NTU

Result Legend:

P=present, A=absent, PR=presumptive, ND=non-detect, OR=over-range, OG=overgrown, Y=yes, N=no,
TNTC=too numerous to count, NR=no result, NT=not tested, IG=ignore, ER=external report, SC=see comment

< means less than lower detection limit shown
> means greater than upper detection limit shown
« means detected & less than number shown
» means detected & greater than number shown

* Indicates Criteria is exceeded

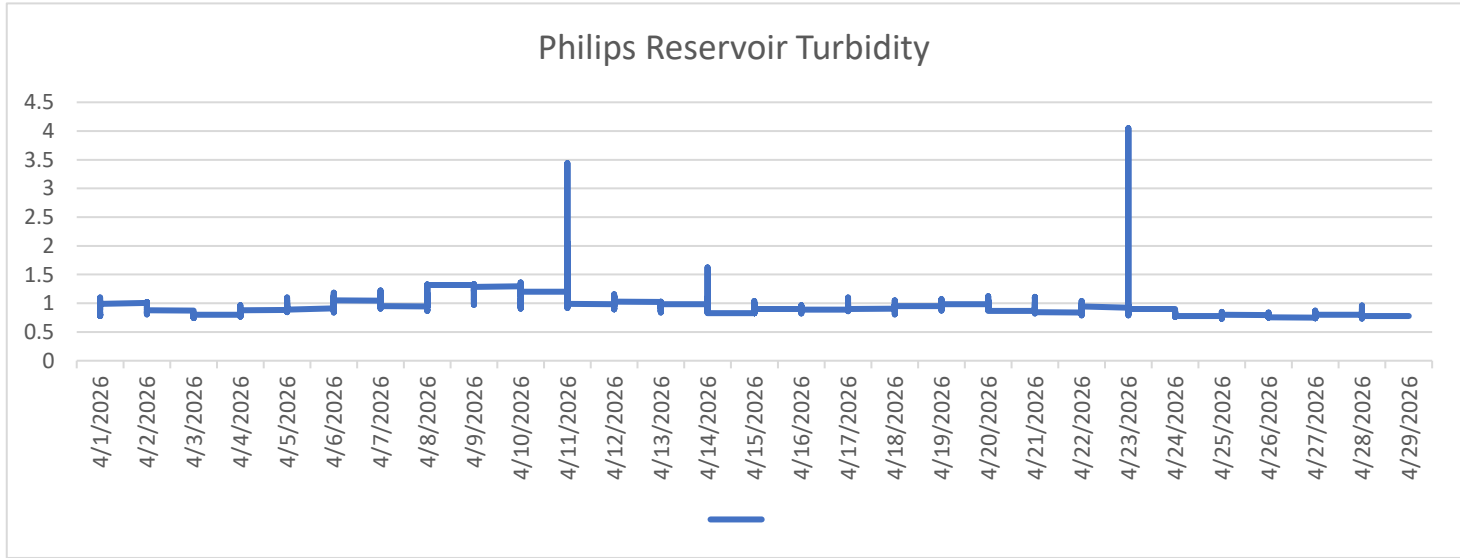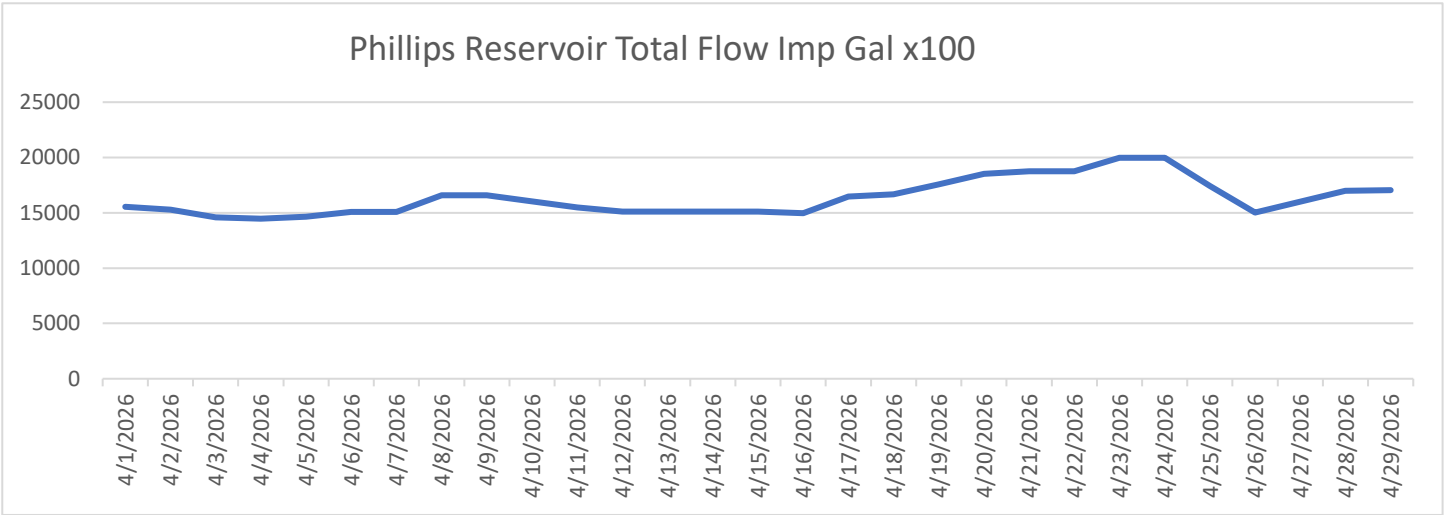

Report Name: Distribution Water Quality Report

Water System	Facility	Sampling Point	Collection Date	Fecal coliforms (counts)	Escherichia coli / E. coli (counts)	Total coliforms (counts)
				Fecal (thermal tolerant) Coliforms (counts)	Escherichia coli / E. coli (counts)	Total Coliforms (counts)
				Lab Data Transfer	Lab Data Transfer	Lab Data Transfer
				CFU/100ml	CFU/100ml	CFU/100ml
City of Cranbrook	Phillips Rese	Phillips Reservoir	04/07/2026	< 1	0	66
City of Cranbrook	Phillips Rese	Phillips Reservoir	04/13/2026	< 1	1.0	91
City of Cranbrook	Phillips Rese	Phillips Reservoir	04/07/2026	0	0	1.0
City of Cranbrook	Phillips Rese	Phillips Reservoir	04/13/2026	0	0	1.0
City of Cranbrook	Distribution S	PR 1 Sampling T	04/13/2026	0	0	0
City of Cranbrook	Distribution S	PR 2 Sampling T	04/07/2026	0	0	0
City of Cranbrook	Distribution S	PR 4- Sample Ta	04/13/2026	0	0	0
City of Cranbrook	Distribution S	PR 6 - Sampling	04/07/2026	0	0	0
City of Cranbrook	Distribution S	PR 8 - Sampling	04/07/2026	0	0	0
City of Cranbrook	Distribution S	PR 9 Sampling T	04/13/2026	0	0	0
City of Cranbrook	Distribution S	PR 11 Sampling	04/13/2026	0	0	0
City of Cranbrook	Distribution S	PR 12 Sampling	04/07/2026	0	0	0
City of Cranbrook	Distribution S	Well #3 - Pump C	04/07/2026	2	7.0	14
City of Cranbrook	Distribution S	Well #3 - Pump C	04/13/2026	< 1	0	0
City of Cranbrook	Distribution S	Well #3 - Pump C	04/17/2026		0**	0**
City of Cranbrook	Distribution S	Well #3- Pump O	04/07/2026	0	0	0
City of Cranbrook	Distribution S	Well #3- Pump O	04/13/2026	0	0	0
City of Cranbrook	Distribution S	Well #3- Pump O	04/17/2026		0**	0**
City of Cranbrook	Distribution S	Well 2- Sampling	04/07/2026	0	0	0
City of Cranbrook	Distribution S	Well 5 - Pump Of	04/13/2026	0	0	0
City of Cranbrook	Distribution S	Gyro Park- Samp	04/13/2026	0	0	0
City of Cranbrook	Distribution S	City Works Yard-	04/07/2026	0	0	0
City of Cranbrook	Distribution S	Well #4. Pump O	04/07/2026	< 1	0	0
City of Cranbrook	Distribution S	Well #4. Pump O	04/13/2026	< 1	0	0
* indicates Geometric Mean						
** indicates Intraday Average						