

Report Name: Interior Health Monthly Report

Water System Data Report Filter Summary

Organization:	City of Cranbrook
User Name:	Joel Schofield
Water System:	City of Cranbrook
Report Description:	Report to Interior Health Authority for the City of Cranbrook.
Report Template Name:	Interior Health Monthly Report
Collection Date Range:	03/01/2026 - 03/31/2026 (mm/dd/yyyy)
Report Type:	Analyte Report by Sampling Point
Reading Types:	Calculated, Lab Data Transfer, Test Kit
Calculate Exceedances:	Apply Measurement Criteria
Show Records for Exceedances Only:	No
Suppress Lists with no Records:	Yes
Treatment of ND Results with Detection Limits in Reports Statistics:	Non-Detect (results are ignored in average statistics)
Treatment of OR Results with Detection Limits in Reports Statistics:	Over-Range (results are ignored in average statistics)
Grouped By:	Sampling Point, List by: Analyte + Reading Type
Sort Records By:	Sampling Point Name

Facility:	Distribution Sample Sites
Sampling Point:	PR 1 Sampling Tap - PRIORITY (1-1-MD, 305F9)

DISINFECTANTS

Chlorine (free)(Test Kit)

# samples:	9	min:	1.12	mg/L
# detects:	9	max:	1.37	mg/L
# non-detects:	0	avg:	1.23	mg/L (based on 9 numerical results)
# exceedances:	0			

Chlorine (total)(Test Kit)

# samples:	9	min:	1.27	mg/L
# detects:	9	max:	1.48	mg/L
# non-detects:	0	avg:	1.38	mg/L (based on 9 numerical results)
# exceedances:	0			

INORGANIC

Manganese (dissolved)(Test Kit)

# samples:	4	min:	0.006	mg/L
# detects:	4	max:	0.067	mg/L
# non-detects:	0	avg:	0.027	mg/L (based on 4 numerical results)
# exceedances:	0			

MICROORGANISMS

Escherichia coli / E. coli (counts)(Lab Data Transfer)

# samples:	1	min:	0	counts/100ml
# detects:	1	max:	0	counts/100ml
# non-detects:	0	Geometric Mean:	0	counts/100ml (based on 1 numerical results)
# exceedances:	0			

Total Coliforms (counts)(Lab Data Transfer)

# samples:	1	min:	0	counts/100ml
# detects:	1	max:	0	counts/100ml
# non-detects:	0	Geometric Mean:	0	counts/100ml (based on 1 numerical results)
# exceedances:	0			

PHYSICAL

Conductivity(Test Kit)

# samples:	9	min:	104.1	uS/cm
# detects:	9	max:	228	uS/cm
# non-detects:	0	avg:	170.5	uS/cm (based on 9 numerical results)
# exceedances:	0			

pH(Test Kit)

# samples:	9	min:	7.18	
# detects:	9	max:	8.76	
# non-detects:	0	avg:	7.97	(based on 9 numerical results)
# exceedances:	0			

Temperature(Test Kit)

# samples:	9	min:	6.2	degrees C
# detects:	9	max:	9.2	degrees C
# non-detects:	0	avg:	7.5	degrees C (based on 9 numerical results)
# exceedances:	0			

Turbidity(Test Kit)

# samples:	9	min:	0.63	NTU
------------	---	------	------	-----

# detects:	9	max:	1.34	NTU
# non-detects:	0	avg:	0.90	NTU (based on 9 numerical results)
# exceedances:	0	95th percentile:	1.34	NTU

Facility:	Distribution Sample Sites			
Sampling Point:	PR 2 Sampling Tap PRIORITY (1-2-MD, 305FA)			

DISINFECTANTS

Chlorine (free)(Test Kit)

# samples:	9	min:	0.67	mg/L
# detects:	9	max:	1.44	mg/L
# non-detects:	0	avg:	0.88	mg/L (based on 9 numerical results)
# exceedances:	0			

Chlorine (total)(Test Kit)

# samples:	9	min:	0.87	mg/L
# detects:	9	max:	1.65	mg/L
# non-detects:	0	avg:	1.06	mg/L (based on 9 numerical results)
# exceedances:	0			

INORGANIC

Manganese (dissolved)(Test Kit)

# samples:	2	min:	0.007	mg/L
# detects:	2	max:	0.046	mg/L
# non-detects:	0	avg:	0.027	mg/L (based on 2 numerical results)
# exceedances:	0			

MICROORGANISMS

Escherichia coli / E. coli (counts)(Lab Data Transfer)

# samples:	1	min:	0	counts/100ml
# detects:	1	max:	0	counts/100ml
# non-detects:	0	Geometric Mean:	0	counts/100ml (based on 1 numerical results)
# exceedances:	0			

Total Coliforms (counts)(Lab Data Transfer)

# samples:	1	min:	0	counts/100ml
# detects:	1	max:	0	counts/100ml
# non-detects:	0	Geometric Mean:	0	counts/100ml (based on 1 numerical results)
# exceedances:	0			

PHYSICAL

Conductivity(Test Kit)

# samples:	9	min:	109.5	uS/cm
# detects:	9	max:	233	uS/cm
# non-detects:	0	avg:	179.4	uS/cm (based on 9 numerical results)
# exceedances:	0			

pH(Test Kit)

# samples:	9	min:	7.16	
# detects:	9	max:	8.62	
# non-detects:	0	avg:	7.95	(based on 9 numerical results)
# exceedances:	0			

Temperature(Test Kit)

# samples:	9	min:	6.2	degrees C
# detects:	9	max:	8.2	degrees C
# non-detects:	0	avg:	7.3	degrees C (based on 9 numerical results)
# exceedances:	0			

Turbidity(Test Kit)

# samples:	9	min:	0.63	NTU
# detects:	9	max:	4.55	NTU
# non-detects:	0	avg:	1.19	NTU (based on 9 numerical results)
# exceedances:	0	95th percentile:	4.55	NTU

Facility:	Distribution Sample Sites
Sampling Point:	PR 4- Sample Tap (1-16-MD, 30672)

DISINFECTANTS

Chlorine (free)(Test Kit)

# samples:	2	min:	0.95	mg/L
# detects:	2	max:	1.10	mg/L
# non-detects:	0	avg:	1.03	mg/L (based on 2 numerical results)
# exceedances:	0			

Chlorine (total)(Test Kit)

# samples:	2	min:	1.17	mg/L
# detects:	2	max:	1.35	mg/L
# non-detects:	0	avg:	1.26	mg/L (based on 2 numerical results)

# exceedances:	0
----------------	---

INORGANIC

Manganese (dissolved)(Test Kit)

# samples:	1	min:	0	mg/L
# detects:	1	max:	0	mg/L
# non-detects:	0	avg:	0	mg/L (based on 1 numerical results)
# exceedances:	0			

MICROORGANISMS

Escherichia coli / E. coli (counts)(Lab Data Transfer)

# samples:	1	min:	0	counts/100ml
# detects:	1	max:	0	counts/100ml
# non-detects:	0	Geometric Mean:	0	counts/100ml (based on 1 numerical results)
# exceedances:	0			

Total Coliforms (counts)(Lab Data Transfer)

# samples:	1	min:	0	counts/100ml
# detects:	1	max:	0	counts/100ml
# non-detects:	0	Geometric Mean:	0	counts/100ml (based on 1 numerical results)
# exceedances:	0			

PHYSICAL

Turbidity(Test Kit)

# samples:	2	min:	0.72	NTU
# detects:	2	max:	1.25	NTU
# non-detects:	0	avg:	0.99	NTU (based on 2 numerical results)
# exceedances:	0	95th percentile:	1.25	NTU

Facility:	Distribution Sample Sites
Sampling Point:	PR 9 Sampling Tap PRIORITY (1-3-MD, 305FB)

DISINFECTANTS

Chlorine (free)(Test Kit)

# samples:	7	min:	0.72	mg/L
# detects:	7	max:	0.93	mg/L
# non-detects:	0	avg:	0.82	mg/L (based on 7 numerical results)
# exceedances:	0			

Chlorine (total)(Test Kit)

# samples:	7	min:	0.83	mg/L
# detects:	7	max:	1.13	mg/L
# non-detects:	0	avg:	1.00	mg/L (based on 7 numerical results)
# exceedances:	0			

INORGANIC

Manganese (dissolved)(Test Kit)

# samples:	3	min:	0.021	mg/L
# detects:	3	max:	0.065	mg/L
# non-detects:	0	avg:	0.049	mg/L (based on 3 numerical results)
# exceedances:	0			

MICROORGANISMS

Escherichia coli / E. coli (counts)(Lab Data Transfer)

# samples:	1	min:	0	counts/100ml
# detects:	1	max:	0	counts/100ml
# non-detects:	0	Geometric Mean:	0	counts/100ml (based on 1 numerical results)
# exceedances:	0			

Total Coliforms (counts)(Lab Data Transfer)

# samples:	1	min:	0	counts/100ml
# detects:	1	max:	0	counts/100ml
# non-detects:	0	Geometric Mean:	0	counts/100ml (based on 1 numerical results)
# exceedances:	0			

PHYSICAL

Conductivity(Test Kit)

# samples:	7	min:	110.2	uS/cm
# detects:	7	max:	227	uS/cm
# non-detects:	0	avg:	182.9	uS/cm (based on 7 numerical results)
# exceedances:	0			

pH(Test Kit)

# samples:	7	min:	7.33	
# detects:	7	max:	8.61	
# non-detects:	0	avg:	8.08	(based on 7 numerical results)
# exceedances:	0			

Temperature(Test Kit)

# samples:	7	min:	6.4	degrees C
# detects:	7	max:	9.1	degrees C
# non-detects:	0	avg:	7.6	degrees C (based on 7 numerical results)
# exceedances:	0			

Turbidity(Test Kit)

# samples:	7	min:	0.5	NTU
# detects:	7	max:	0.81	NTU
# non-detects:	0	avg:	0.65	NTU (based on 7 numerical results)
# exceedances:	0	95th percentile:	0.81	NTU

Facility:	Distribution Sample Sites
Sampling Point:	Well #3 - Pump On Raw PRIORITY (1-22-EP, 31E8C)

MICROORGANISMS

Escherichia coli / E. coli (counts)(Lab Data Transfer)

# samples:	1	min:	0	counts/100ml
# detects:	1	max:	0	counts/100ml
# non-detects:	0	Geometric Mean:	0	counts/100ml (based on 1 numerical results)
# exceedances:	0			

Total Coliforms (counts)(Lab Data Transfer)

# samples:	1	min:	0	counts/100ml
# detects:	1	max:	0	counts/100ml
# non-detects:	0	Geometric Mean:	0	counts/100ml (based on 1 numerical results)
# exceedances:	0			

PHYSICAL

Conductivity(Test Kit)

# samples:	12	min:	655	uS/cm
# detects:	12	max:	877	uS/cm
# non-detects:	0	avg:	724	uS/cm (based on 12 numerical results)
# exceedances:	0			

pH(Test Kit)

# samples:	12	min:	7.25
# detects:	12	max:	7.85

# non-detects:	0	avg:	7.62	(based on 12 numerical results)
# exceedances:	0			

Temperature(Test Kit)

# samples:	12	min:	9.7	degrees C
# detects:	12	max:	11.3	degrees C
# non-detects:	0	avg:	10.4	degrees C (based on 12 numerical results)
# exceedances:	0			

Turbidity(Test Kit)

# samples:	13	min:	0.12	NTU
# detects:	13	max:	0.67	NTU
# non-detects:	0	avg:	0.30	NTU (based on 13 numerical results)
# exceedances:	0	95th percentile:	0.67	NTU

Facility:	Distribution Sample Sites
Sampling Point:	Well #3- Pump On Potable PRIORITY (1-21-EP, 31E8B)

DISINFECTANTS

Chlorine (free)(Test Kit)

# samples:	12	min:	0.61	mg/L
# detects:	12	max:	1.23	mg/L
# non-detects:	0	avg:	0.90	mg/L (based on 12 numerical results)
# exceedances:	0			

Chlorine (total)(Test Kit)

# samples:	11	min:	0.80	mg/L
# detects:	11	max:	1.34	mg/L
# non-detects:	0	avg:	0.98	mg/L (based on 11 numerical results)
# exceedances:	0			

MICROORGANISMS

Escherichia coli / E. coli (counts)(Lab Data Transfer)

# samples:	1	min:	0	counts/100ml
# detects:	1	max:	0	counts/100ml
# non-detects:	0	Geometric Mean:	0	counts/100ml (based on 1 numerical results)
# exceedances:	0			

Total Coliforms (counts)(Lab Data Transfer)

# samples:	1	min:	0	counts/100ml
# detects:	1	max:	0	counts/100ml
# non-detects:	0	Geometric Mean:	0	counts/100ml (based on 1 numerical results)
# exceedances:	0			

PHYSICAL

Conductivity(Test Kit)

# samples:	12	min:	661	uS/cm
# detects:	12	max:	890	uS/cm
# non-detects:	0	avg:	730	uS/cm (based on 12 numerical results)
# exceedances:	0			

pH(Test Kit)

# samples:	12	min:	7.34	
# detects:	12	max:	7.78	
# non-detects:	0	avg:	7.53	(based on 12 numerical results)
# exceedances:	0			

Temperature(Test Kit)

# samples:	12	min:	9.7	degrees C
# detects:	12	max:	11.4	degrees C
# non-detects:	0	avg:	10.1	degrees C (based on 12 numerical results)
# exceedances:	0			

Turbidity(Test Kit)

# samples:	12	min:	0.09	NTU
# detects:	12	max:	0.73	NTU
# non-detects:	0	avg:	0.30	NTU (based on 12 numerical results)
# exceedances:	0	95th percentile:	0.73	NTU

Facility:	Distribution Sample Sites
Sampling Point:	Well #4. Pump On - Potable PRIORITY (1-27-EP, 3425D)

DISINFECTANTS

Chlorine (free)(Test Kit)

# samples:	14	min:	0.69	mg/L
# detects:	14	max:	0.95	mg/L
# non-detects:	0	avg:	0.80	mg/L (based on 14 numerical results)
# exceedances:	0			

Chlorine (total)(Test Kit)

# samples:	14	min:	0.72	mg/L
# detects:	14	max:	1.11	mg/L
# non-detects:	0	avg:	0.90	mg/L (based on 14 numerical results)
# exceedances:	0			

PHYSICAL

Conductivity(Test Kit)

# samples:	15	min:	361	uS/cm
# detects:	15	max:	743	uS/cm
# non-detects:	0	avg:	603	uS/cm (based on 15 numerical results)
# exceedances:	0			

pH(Test Kit)

# samples:	15	min:	7.23	
# detects:	15	max:	7.99	
# non-detects:	0	avg:	7.66	(based on 15 numerical results)
# exceedances:	0			

Temperature(Test Kit)

# samples:	15	min:	9.1	degrees C
# detects:	15	max:	11.6	degrees C
# non-detects:	0	avg:	9.8	degrees C (based on 15 numerical results)
# exceedances:	0			

Turbidity(Test Kit)

# samples:	15	min:	0.15	NTU
# detects:	15	max:	0.71	NTU
# non-detects:	0	avg:	0.37	NTU (based on 15 numerical results)
# exceedances:	0	95th percentile:	0.71	NTU

Facility:	Distribution Sample Sites
Sampling Point:	Well #4. Pump On - Raw PRIORITY (1-26-EP, 3425C)

INORGANIC

Manganese (dissolved)(Test Kit)

# samples:	3	min:	0.043	mg/L
# detects:	3	max:	0.079	mg/L
# non-detects:	0	avg:	0.066	mg/L (based on 3 numerical results)

# exceedances:	0
----------------	---

MICROORGANISMS

Escherichia coli / E. coli (counts)(Lab Data Transfer)

# samples:	2	min:	0	counts/100ml
# detects:	2	max:	0	counts/100ml
# non-detects:	0	Geometric Mean:	0	counts/100ml (based on 2 numerical results)
# exceedances:	0			

Total Coliforms (counts)(Lab Data Transfer)

# samples:	2	min:	0	counts/100ml
# detects:	2	max:	0	counts/100ml
# non-detects:	0	Geometric Mean:	0	counts/100ml (based on 2 numerical results)
# exceedances:	0			

PHYSICAL

Conductivity(Test Kit)

# samples:	15	min:	363	uS/cm
# detects:	15	max:	737	uS/cm
# non-detects:	0	avg:	599	uS/cm (based on 15 numerical results)
# exceedances:	0			

pH(Test Kit)

# samples:	15	min:	7.36	
# detects:	15	max:	7.98	
# non-detects:	0	avg:	7.71	(based on 15 numerical results)
# exceedances:	0			

Temperature(Test Kit)

# samples:	15	min:	9.1	degrees C
# detects:	15	max:	10.8	degrees C
# non-detects:	0	avg:	10.0	degrees C (based on 15 numerical results)
# exceedances:	0			

Turbidity(Test Kit)

# samples:	15	min:	0.11	NTU
# detects:	15	max:	0.67	NTU
# non-detects:	0	avg:	0.30	NTU (based on 15 numerical results)
# exceedances:	0	95th percentile:	0.67	NTU

Facility:	Phillips Reservoir; Phillips Reservoir - Plant
Sampling Point:	Phillips Reservoir POTABLE PRIORITY (16-1-IT, 30653)

DISINFECTANTS

Chlorine (free)(Test Kit)

# samples:	19	min:	1.40	mg/L
# detects:	19	max:	1.90	mg/L
# non-detects:	0	avg:	1.60	mg/L (based on 19 numerical results)
# exceedances:	0			

Chlorine (total)(Test Kit)

# samples:	19	min:	1.69	mg/L
# detects:	19	max:	2.03	mg/L
# non-detects:	0	avg:	1.85	mg/L (based on 19 numerical results)
# exceedances:	0			

INORGANIC

Dissolved Oxygen(Test Kit)

# samples:	19	min:	6.61	mg/L
# detects:	19	max:	11.51	mg/L
# non-detects:	0	avg:	7.60	mg/L (based on 19 numerical results)
# exceedances:	0			

Fluoride(Lab Data Transfer)

# samples:	2	min:	0.44	mg/L
# detects:	2	max:	0.45	mg/L
# non-detects:	0	avg:	0.45	mg/L (based on 2 numerical results)
# exceedances:	0			

MICROORGANISMS

Escherichia coli / E. coli (counts)(Lab Data Transfer)

# samples:	2	min:	0	counts/100ml
# detects:	2	max:	0	counts/100ml
# non-detects:	0	Geometric Mean:	0	counts/100ml (based on 2 numerical results)
# exceedances:	0			

Total Coliforms (counts)(Lab Data Transfer)

# samples:	2	min:	0	counts/100ml
# detects:	2	max:	0	counts/100ml
# non-detects:	0	Geometric Mean:	0	counts/100ml (based on 2 numerical results)
# exceedances:	0			

PHYSICAL

Conductivity(Lab Data Transfer)

# samples:	2	min:	220	uS/cm
# detects:	2	max:	220	uS/cm
# non-detects:	0	avg:	220	uS/cm (based on 2 numerical results)
# exceedances:	0			

Conductivity(Test Kit)

# samples:	19	min:	150.7	uS/cm
# detects:	19	max:	223	uS/cm
# non-detects:	0	avg:	181.5	uS/cm (based on 19 numerical results)
# exceedances:	0			

pH(Lab Data Transfer)

# samples:	2	min:	7.54	
# detects:	2	max:	7.77	
# non-detects:	0	avg:	7.66	(based on 2 numerical results)
# exceedances:	0			

pH(Test Kit)

# samples:	19	min:	6.89	
# detects:	19	max:	8.35	
# non-detects:	0	avg:	7.64	(based on 19 numerical results)
# exceedances:	0			

Temperature(Test Kit)

# samples:	19	min:	0.85	degrees C
# detects:	19	max:	6.7	degrees C
# non-detects:	0	avg:	5.44	degrees C (based on 19 numerical results)
# exceedances:	0			

Turbidity(Lab Data Transfer)

# samples:	2	min:	0.74	NTU
# detects:	2	max:	0.86	NTU
# non-detects:	0	avg:	0.80	NTU (based on 2 numerical results)

# exceedances:	0	95th percentile:	0.86	NTU
----------------	---	------------------	------	-----

Turbidity(Test Kit)

# samples:	19	min:	0.66	NTU
# detects:	19	max:	0.94	NTU
# non-detects:	0	avg:	0.80	NTU (based on 19 numerical results)
# exceedances:	0	95th percentile:	0.94	NTU

Facility:	Phillips Reservoir; Phillips Reservoir - Plant
Sampling Point:	Phillips Reservoir RAW PRIORITY (16-2-SR, 30666)

INORGANIC

Dissolved Oxygen(Test Kit)

# samples:	20	min:	6.54	mg/L
# detects:	20	max:	11.9	mg/L
# non-detects:	0	avg:	7.91	mg/L (based on 20 numerical results)
# exceedances:	0			

Fluoride(Lab Data Transfer)

# samples:	2	min:	< 0.050	mg/L
# detects:	0	max:	< 0.050	mg/L
# non-detects:	2	avg:	n/a	(based on 0 numerical results)
# exceedances:	0			

Fluoride(Test Kit)

# samples:	2	min:	0.62	mg/L
# detects:	2	max:	0.65	mg/L
# non-detects:	0	avg:	0.64	mg/L (based on 2 numerical results)
# exceedances:	0			

Manganese (dissolved)(Test Kit)

# samples:	2	min:	0.039	mg/L
# detects:	2	max:	0.085	mg/L
# non-detects:	0	avg:	0.062	mg/L (based on 2 numerical results)
# exceedances:	0			

MICROORGANISMS

Escherichia coli / E. coli (counts)(Lab Data Transfer)

# samples:	2	min:	0	counts/100ml
------------	---	------	---	--------------

# detects:	2	max:	0	counts/100ml
# non-detects:	0	Geometric Mean:	0	counts/100ml (based on 2 numerical results)
# exceedances:	0			

Total Coliforms (counts)(Lab Data Transfer)

# samples:	2	min:	2.0	CFU/100ml
# detects:	2	max:	13	CFU/100ml
# non-detects:	0	Geometric Mean:	5.1	CFU/100ml (based on 2 numerical results)
# exceedances:	0			

PHYSICAL

Conductivity(Lab Data Transfer)

# samples:	2	min:	220	uS/cm
# detects:	2	max:	220	uS/cm
# non-detects:	0	avg:	220	uS/cm (based on 2 numerical results)
# exceedances:	0			

Conductivity(Test Kit)

# samples:	20	min:	151.9	uS/cm
# detects:	20	max:	223	uS/cm
# non-detects:	0	avg:	178.1	uS/cm (based on 20 numerical results)
# exceedances:	0			

pH(Lab Data Transfer)

# samples:	2	min:	7.68	
# detects:	2	max:	7.87	
# non-detects:	0	avg:	7.78	(based on 2 numerical results)
# exceedances:	0			

pH(Test Kit)

# samples:	20	min:	7.06	
# detects:	20	max:	8.5	
# non-detects:	0	avg:	7.81	(based on 20 numerical results)
# exceedances:	0			

Temperature(Test Kit)

# samples:	20	min:	5.2	degrees C
# detects:	20	max:	9.0	degrees C
# non-detects:	0	avg:	6.6	degrees C (based on 20 numerical results)
# exceedances:	0			

Turbidity(Lab Data Transfer)

# samples:	2	min:	0.61	NTU
# detects:	2	max:	0.93	NTU
# non-detects:	0	avg:	0.77	NTU (based on 2 numerical results)
# exceedances:	0	95th percentile:	0.93	NTU

Turbidity(Test Kit)


# samples:	20	min:	0.62	NTU
# detects:	20	max:	0.93	NTU
# non-detects:	0	avg:	0.81	NTU (based on 20 numerical results)
# exceedances:	0	95th percentile:	0.93	NTU


Result Legend:

P=present, A=absent, PR=presumptive, ND=non-detect, OR=over-range, OG=overgrown, Y=yes, N=no,
TNTC=too numerous to count, NR=no result, NT=not tested, IG=ignore, ER=external report, SC=see comment

- < means less than lower detection limit shown
- > means greater than upper detection limit shown
- « means detected & less than number shown
- » means detected & greater than number shown

* Indicates Criteria is exceeded

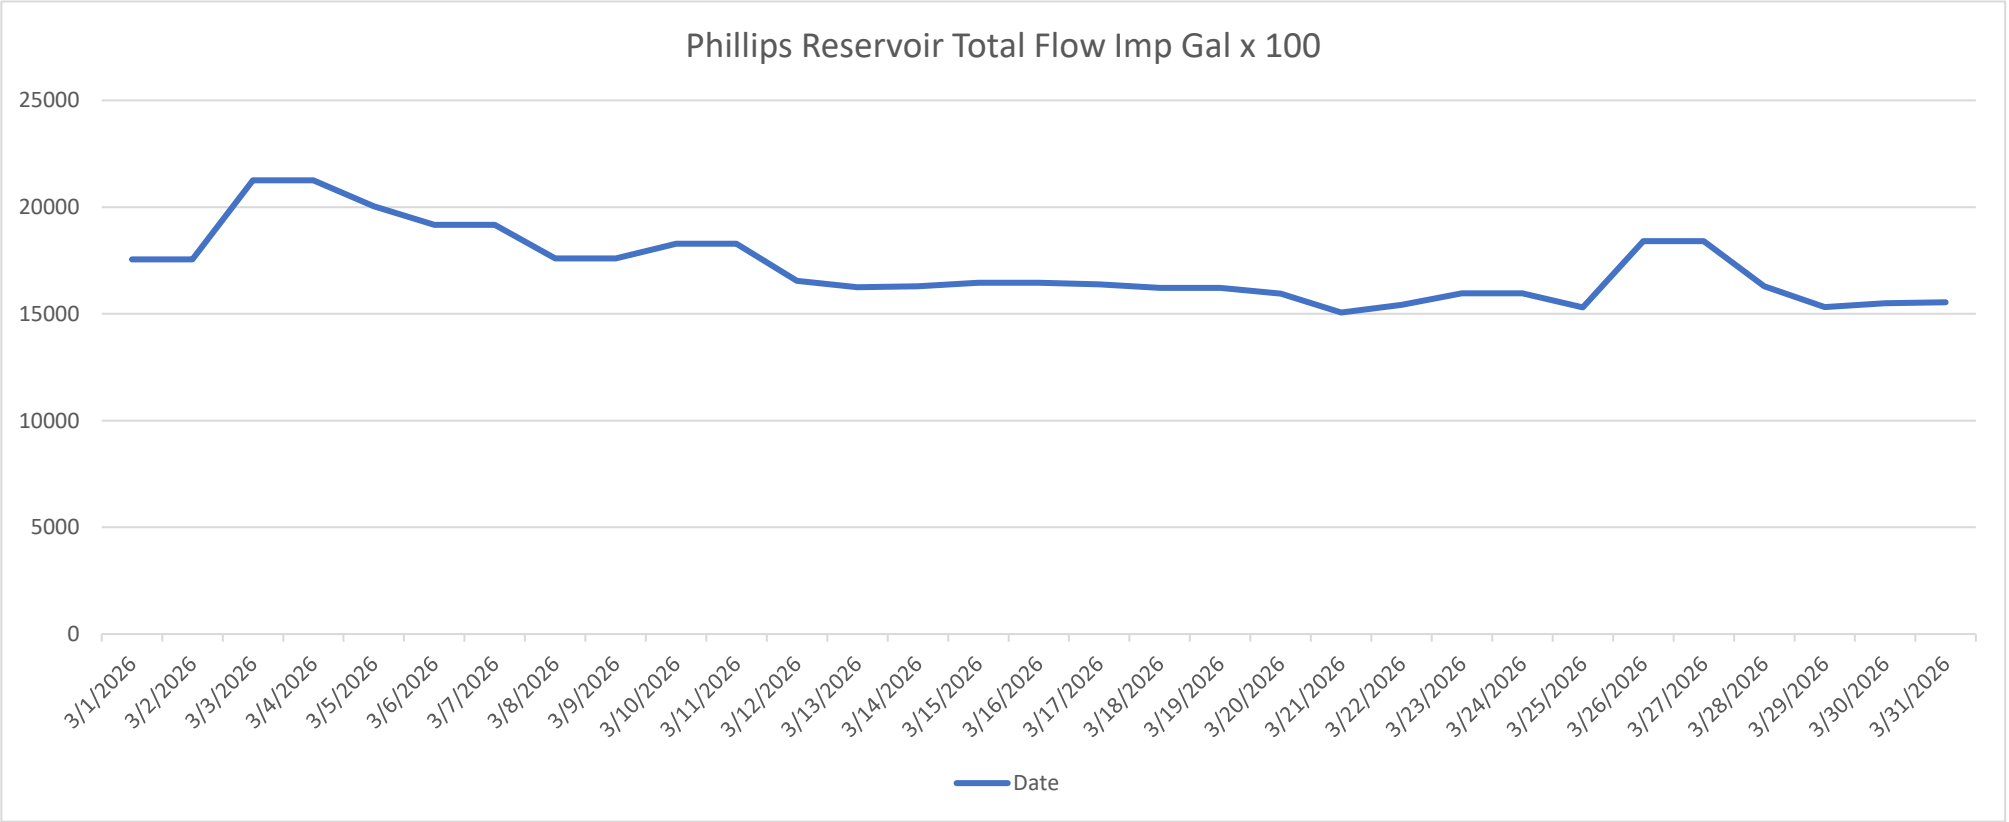

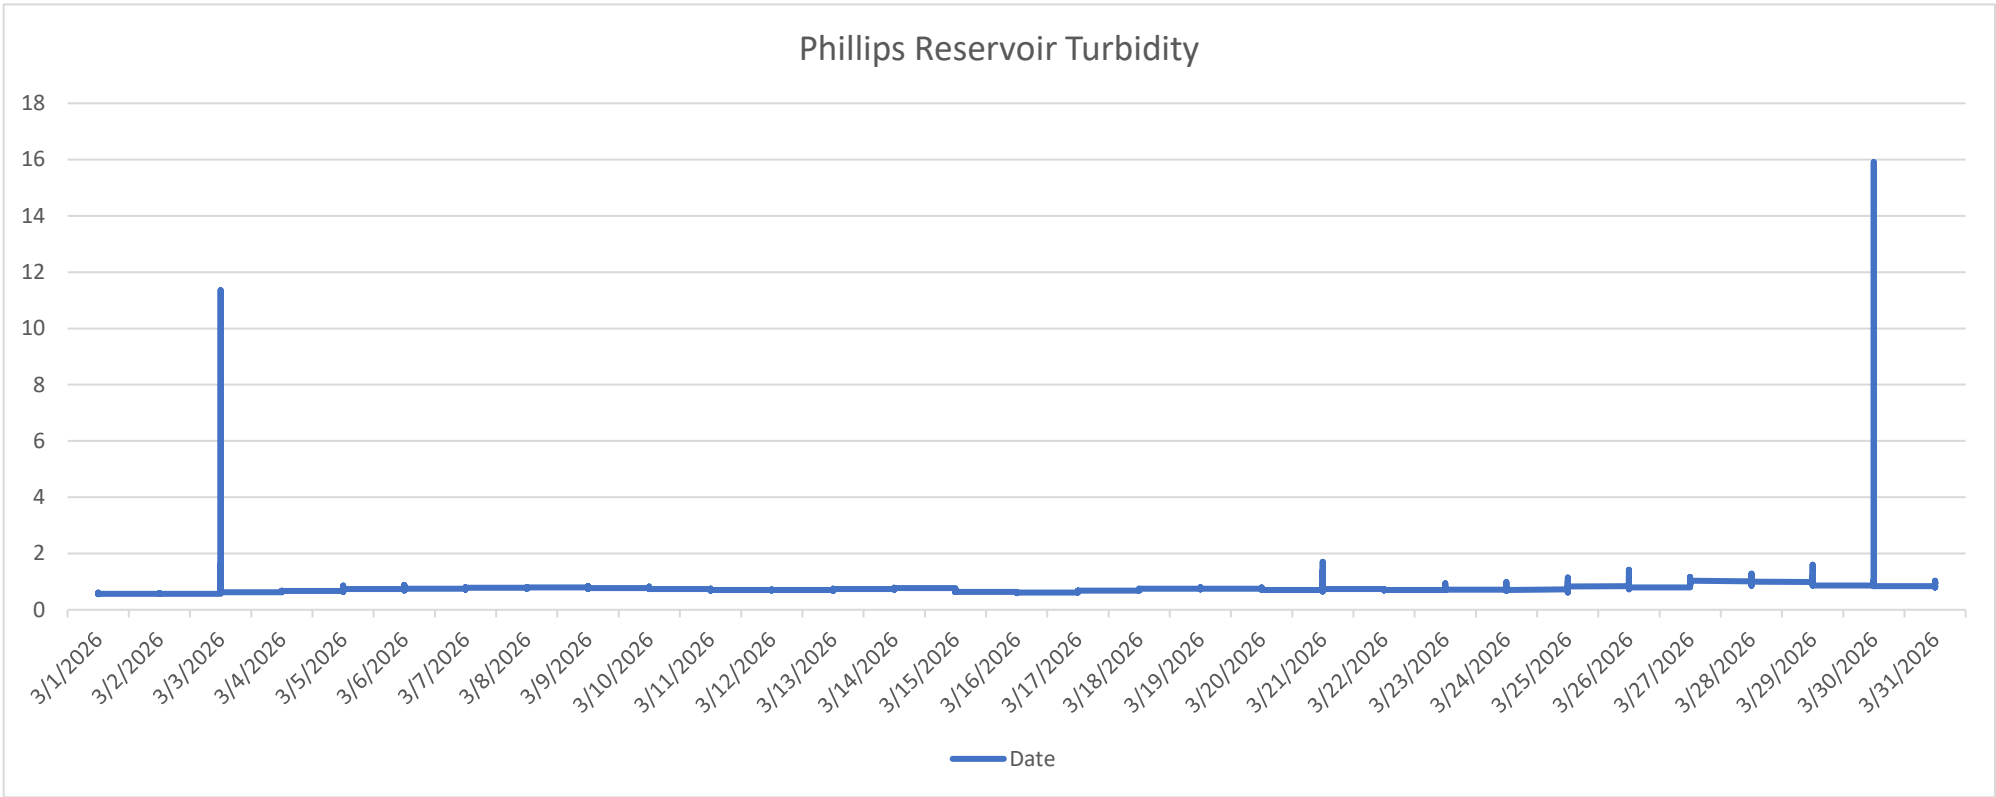

Report Name: Distribution Water Quality Report

Water System	Facility	Sampling Point	Collection Date	Total coliforms (counts)	Background Bacteria	Background Bacteria	Fecal coliforms (counts)	Escherichia coli / E. coli (counts)
				Total Coliforms (counts)	Background Bacteria	Background Bacteria	Fecal (thermal tolerant) Coliforms (counts)	Escherichia coli / E. coli (counts)
				Lab Data Transfer	Lab Data Transfer counts/100m	Lab Data Transfer	Lab Data Transfer	Lab Data Transfer
				CFU/100ml	I	CFU/100ml	CFU/100ml	CFU/100ml
City of Cranbrook	Phillips Rese	Phillips Reservoir RAW PRIORITY	03/09/2026	13	64		< 1	0
City of Cranbrook	Phillips Rese	Phillips Reservoir RAW PRIORITY	03/23/2026	2.0	7		< 1	0
City of Cranbrook	Phillips Rese	Phillips Reservoir POTABLE PRIORITY	03/09/2026	0	< 1		0	0
City of Cranbrook	Phillips Rese	Phillips Reservoir POTABLE PRIORITY	03/23/2026	0	< 1		0	0
City of Cranbrook	Distribution	SPR 1 Sampling Tap - PRIORITY	03/23/2026	0	< 1		0	0
City of Cranbrook	Distribution	SPR 2 Sampling Tap PRIORITY	03/09/2026	0	< 1		0	0
City of Cranbrook	Distribution	SPR 4- Sample Tap	03/23/2026	0	< 1		0	0
City of Cranbrook	Distribution	SPR 6 - Sampling Tap	03/09/2026	0	< 1		0	0
City of Cranbrook	Distribution	SPR 8 - Sampling Tap	03/09/2026	0	< 1		0	0
City of Cranbrook	Distribution	SPR 9 Sampling Tap PRIORITY	03/23/2026	0	< 1		0	0
City of Cranbrook	Distribution	SPR 11 Sampling Tap	03/23/2026	0	< 1		0	0
City of Cranbrook	Distribution	SPR 12 Sampling Tap	03/09/2026	0		< 1	0	0
City of Cranbrook	Distribution	SWell #3 - Pump On Raw PRIORITY	03/23/2026	0		< 1	< 1	0

City of Cranbrook	Distribution S Well #3- Pump On Potable PRIORITY	03/23/2026	0	< 1	0	0
City of Cranbrook	Distribution S Well 2- Sampling Tap	03/09/2026	0	< 1	0	0
City of Cranbrook	Distribution S Well 5 - Pump OFF	03/23/2026	0	< 1	0	0
City of Cranbrook	Distribution S Gyro Park- Sampling Tap	03/23/2026	0	< 1	0	0
City of Cranbrook	Distribution S City Works Yard-Janitors Room	03/09/2026	0	5	0	0

* indicates Geometric Mean

** indicates Intraday Average